


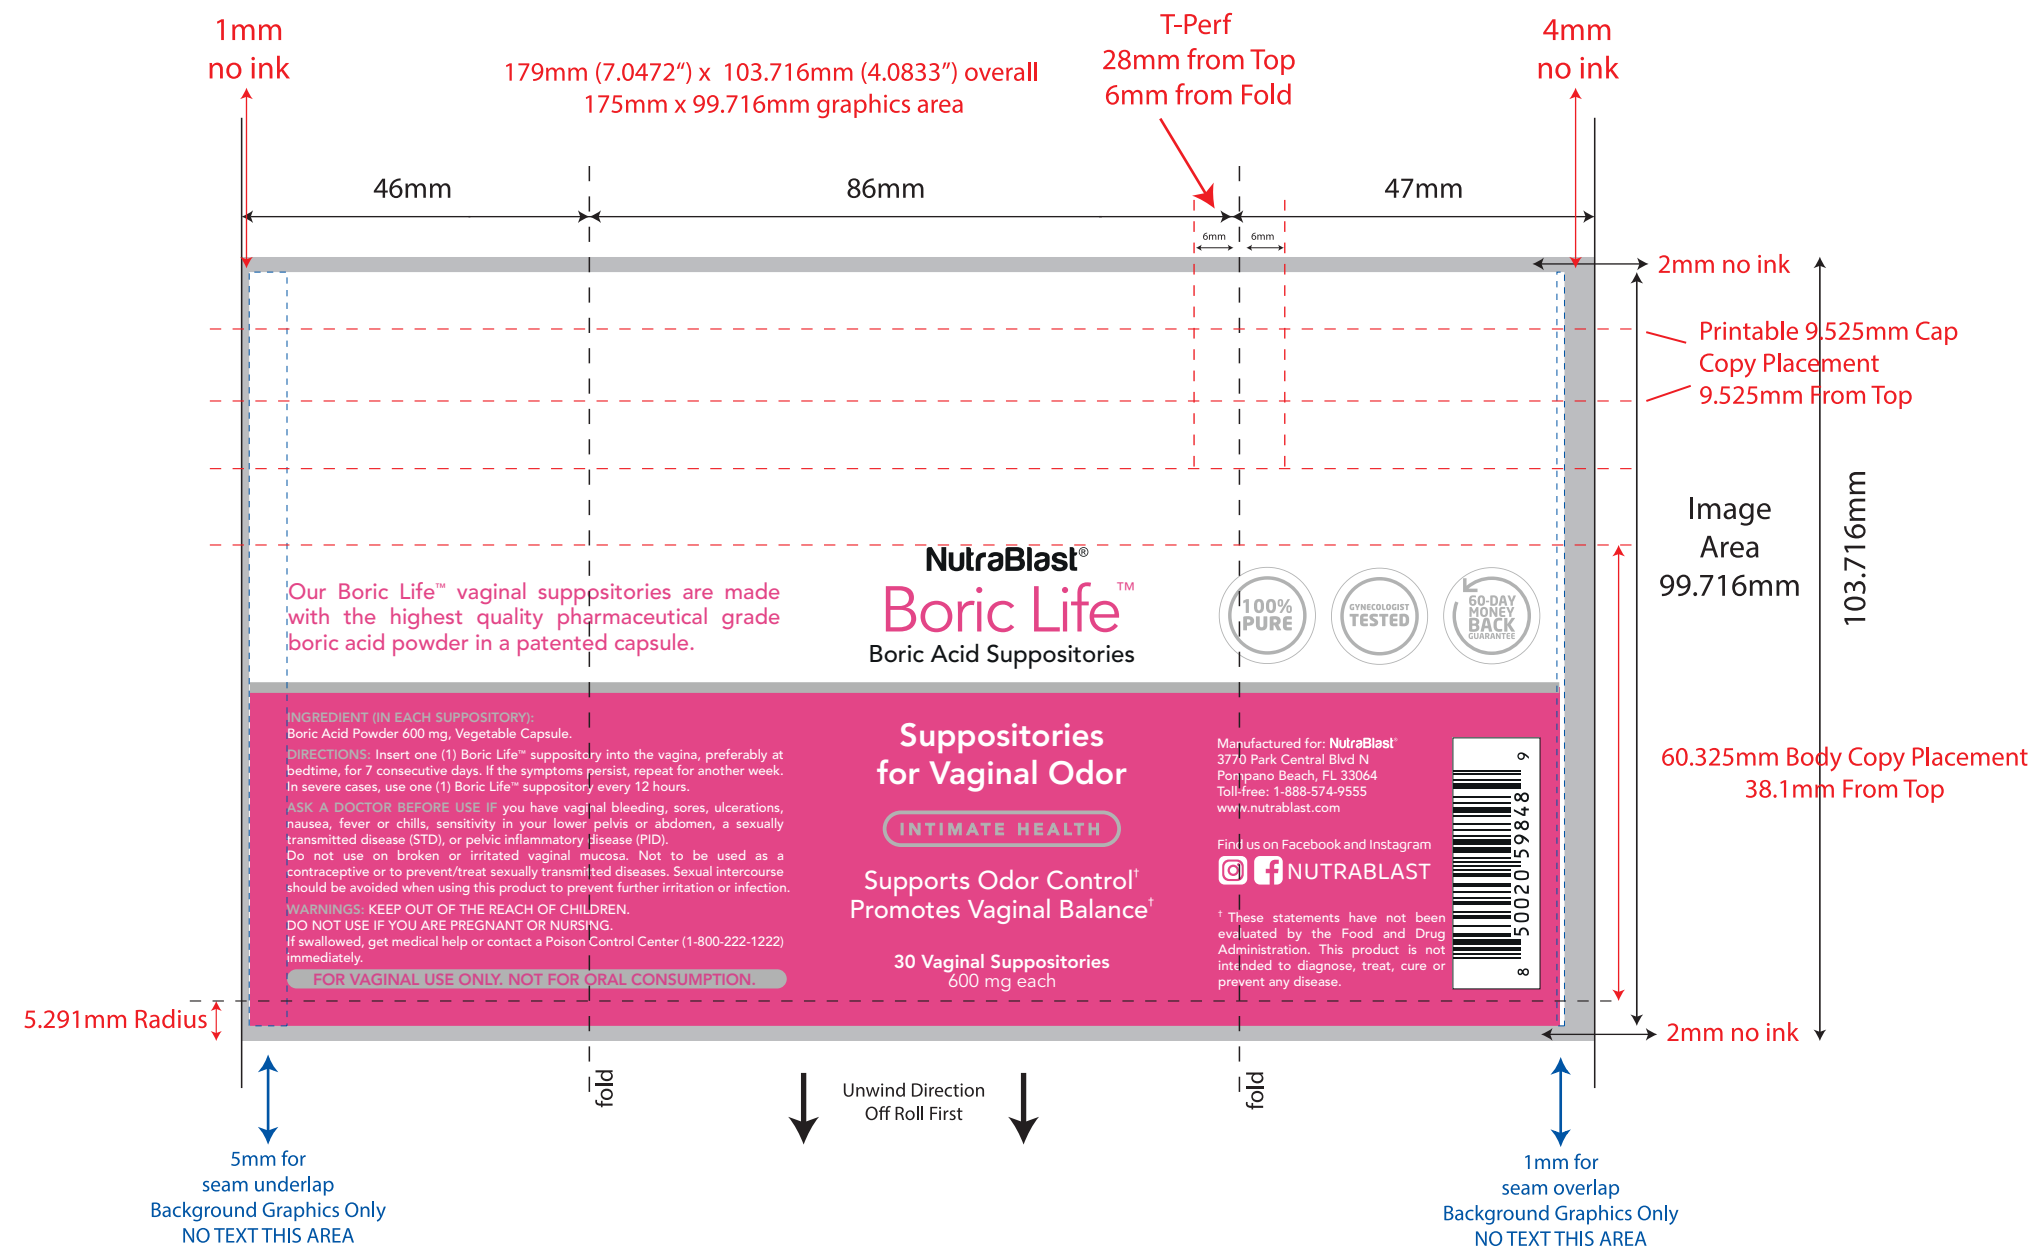


4/12/24
Template No. 12,953.1
Nutra Blast
Boric Life
Intimate Health
86mmLF x 103.716mmCL
Slit Width 179mm
Image Width 174mm
Image Height 99.716mm
98T • 3 Around
PETG-LV
Cut Band
Changed LF and CL customer provided a Bottle 4/10/24

NOTE: RECREATED UPC. PLEASE PROOF CAREFULLY
NO CHANGES WILL BE ACCEPTED UNLESS INDICATED ON THIS PROOF AND FAXED BACK

Date: 5/1/24 Proof # 1 Prepared by: AW Emailed @ _____ Bar Code Scanned _____
Date: 5/1/24 Proof # 2 Prepared by: DD Emailed @ _____ Bar Code Scanned _____

Customer: Nutra Blast
Job Ticket #: 231667
Plate #: 94633
Size: Across x Around - 7.0472 x 4.08333
Corner Radius: 0
Colors: Black, 226, Cool Gray 5, White, CFA, Matte
Stock: PETGLV 50micron
Unwind Direction: 2

PROOF #2
PLEASE CHECK ENTIRE LABEL- NOT JUST ANY CHANGES THAT WERE MADE

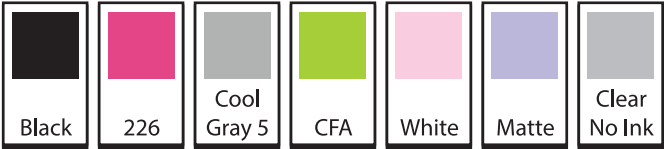

This proof is for color break as well as content. If job is not printed CMYK, we will match the spot colors indicated. Please read the proof thoroughly to ensure that all copy is correct. Sometimes during electronic transmission copy may re-align or drop off. Fonts may replace. Please check. Please double check color separations and that the proper colors and the amount of colors are listed. Double-check the size of your label (if the proof is a faxed copy the dimensions listed will be our responsibility). Once this proof is signed off, responsibility lies solely with the customer for the items listed above unless there is a subsequent error on the part of Overnight Labels.

Note: If the colors on your job need to match a previously printed label, a sample must be provided at time of order.

I have read the preceding statement and proofed the label according to the instructions.



Customer Signature: _____ Std. Form 1005 8/16/10